


Floor Air Outlet Duct Replacement - Left Side (RHD)

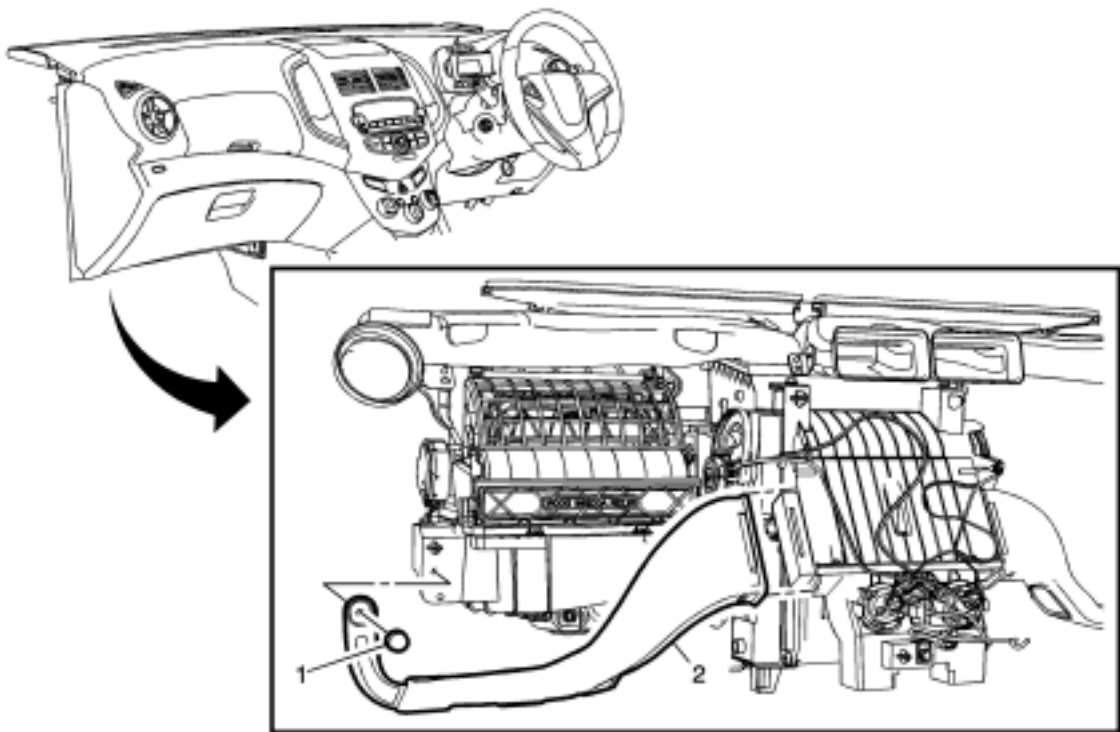

Callout	Component Name
<b>Preliminary Procedure</b> Remove the instrument panel compartment housing. Refer to <a href="#">Instrument Panel Compartment Housing Replacement</a> .	
1	Floor Air Outlet Duct Fastener
2	Floor Air Outlet Duct