


Floor Air Outlet Duct Replacement - Right Side (RHD)

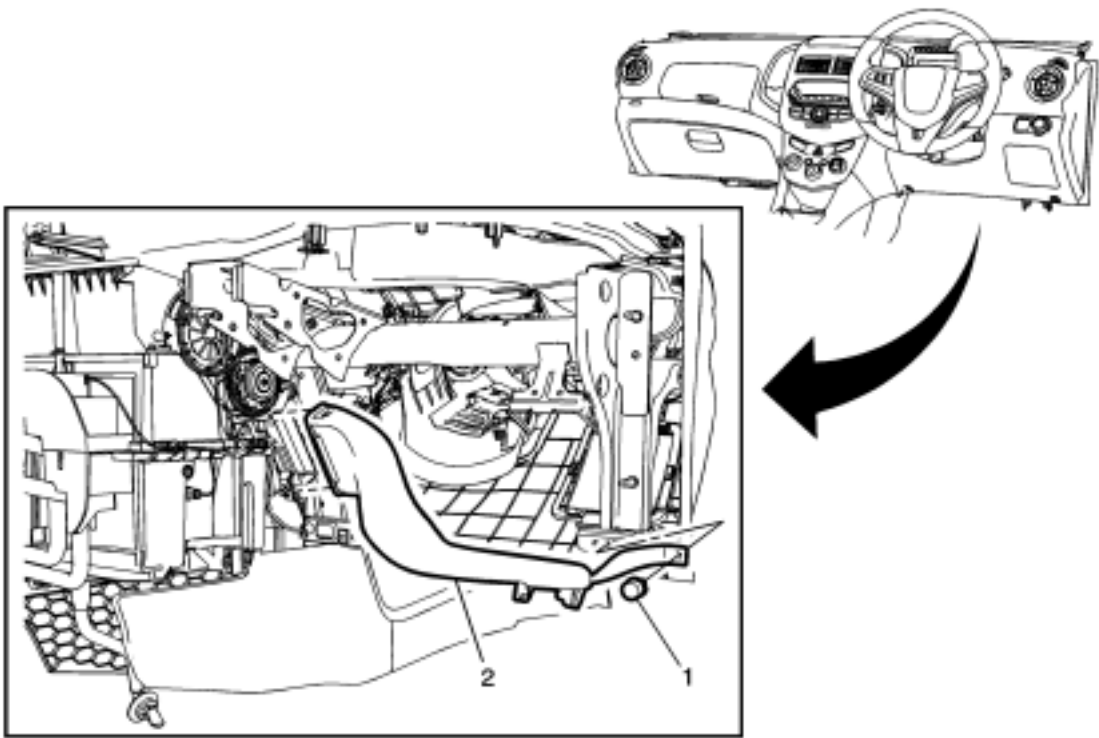

Callout	Component Name
<p>Preliminary Procedure</p> <p>1. Remove the instrument panel insulator, if equipped.</p> <p>2. Remove the instrument panel lower trim pad cover. Refer to Instrument Panel Lower Trim Pad Cover Replacement .</p>	
1	Floor Air Outlet Duct Fastener
2	Floor Air Outlet Duct