


Radio Cooling Duct Replacement (Right Hand Drive)

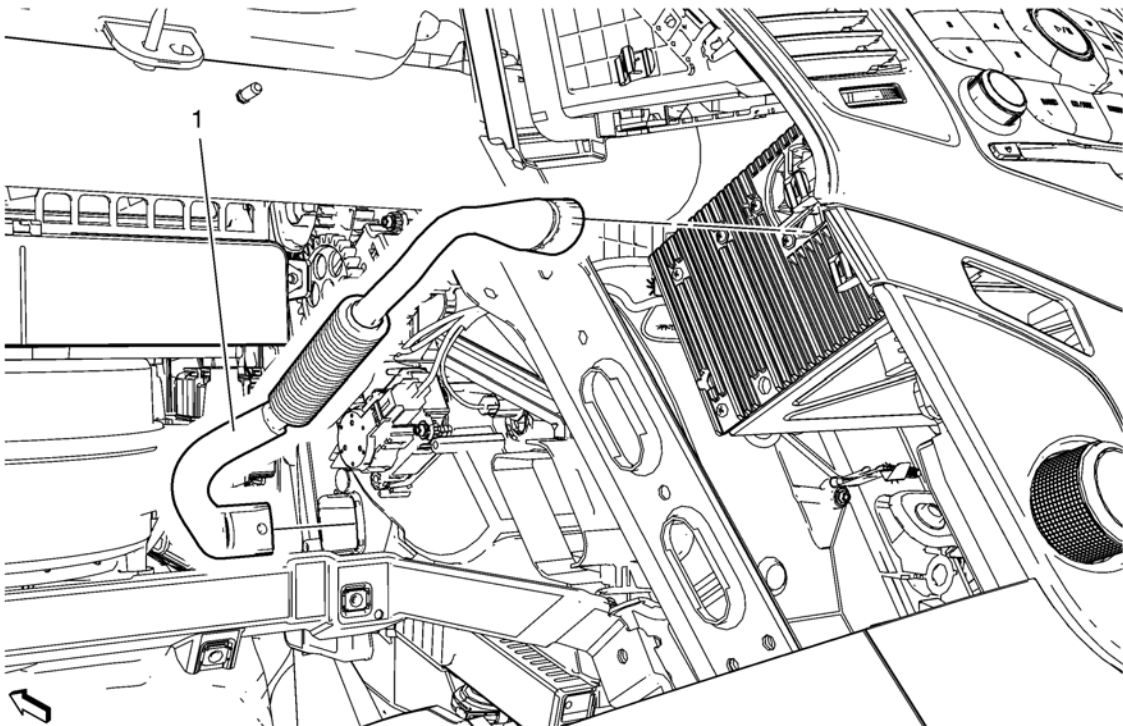

Callout	Component Name
<p>Preliminary Procedure</p> <p>1. Remove IP Compartment. Refer to Instrument Panel Compartment Replacement.</p> <p>2. Remove floor air outlet duct - left side. Refer to Floor Air Outlet Duct Replacement - Left Side.</p>	
1	<p>Radio Cooling Duct</p> <p>Procedure</p> <p>Remove radio cooling duct.</p>